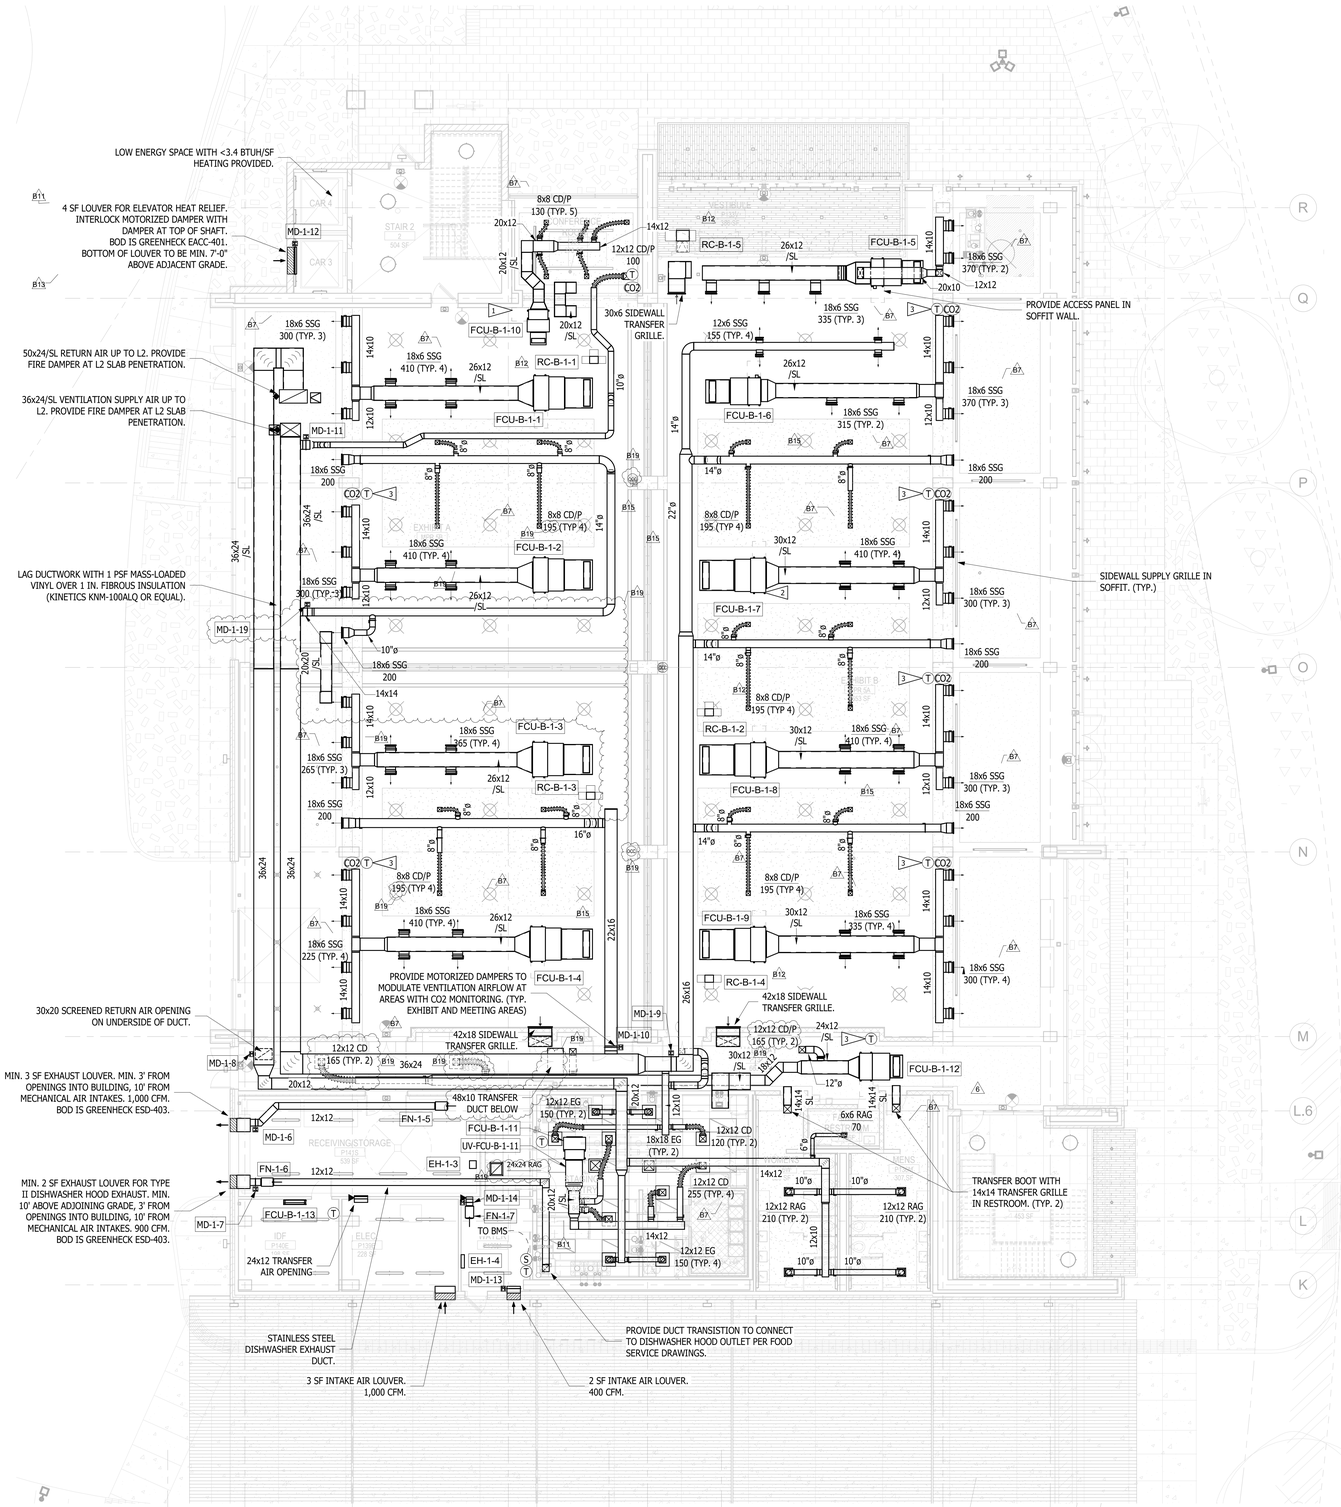


MECHANICAL PLAN - GARAGE L1 (NORTH)
1/8" = 1'-0"

## GENERAL NOTES:

1. PROVIDE CABLE OPERATED DAMPERS AND REMOTE OPERATOR FOR ALL MANUAL VOLUME DAMPERS SHOWN ABOVE GYPSUM HARDLID CEILING.
2. RETURN AIR PLENUM ABOVE ALL CEILINGS. MATERIAL ABOVE CEILING TO BE FIRE RATED PER IMC CHAPTER 6.
3. REFRIGERANT PIPING TO BE INSTALLED PER PIPING DIAGRAM M600 AND MANUFACTURER INSTALLATION REQUIREMENTS. MECHANICAL CONTRACTOR IS RESPONSIBLE FOR FINAL ROUTING OF PIPING TO EACH UNIT PER 2015 IMC REQUIREMENTS AND SPECIFICATIONS.
4. SEE DETAIL 3/M501 FOR FAN COIL INSTALLATION DETAILS.

## FLAG NOTES:

1. FILTER PULL AND ELECTRICAL ACCESS CLEARANCES. (TYP.)
2. PROVIDE 3/4" CONDENSATE, ROUTE TO MOP SINK OR HUB DRAIN. PROVIDED BY P.C. REFER TO PLUMBING DRAWINGS FOR INDIRECT RECEPTOR LOCATION AND 4/M501 FOR CONDENSATE DRAIN DETAIL. CONTRACTOR TO VERIFY FINAL COORDINATED ROUTING PER CODE REQUIREMENTS. (TYP.)
3. INTERLOCK FAN COIL THERMOSTATS VIA BACNET INTERFACE PROGRAMMING TO COMPLY WITH 2015 WSEC C403.2.4.1 TO PREVENT ONE ZONE IN HEATING WHILE THE OTHER ZONE IS IN COOLING EXCEPT WHERE ALLOWED PER EXCEPTION 2.

COSTCO WHOLESALE
999 Lake Dr, Issaquah, WA 98027

RUSHING
Engineering–Essentials–Delivery
1725 WESTLAKE AVENUE NORTH · SUITE 300
SEATTLE, WASHINGTON 98109
P: (206) 285-7100 F: (206) 285-7111

1101 Second Ave, Ste 100
Seattle, WA 98101
206 962 6500
MG2.com

CONSTRUCTION SET

SEPTEMBER 6, 2019

PR19
12/17/2020

ERIC K. VANDER MEY, ENGINEER
12/16/2020

© MG2 Inc All rights reserved. No part of this document may be reproduced in any form or by any means without permission in writing from MG2, Inc.

| △ | DATE | DESCRIPTION |
|---|---|---|
| 6 | 1/27/20 | RVN01 |
| B7 | 2/6/20 | PR-B7 |
| B11 | 6/10/20 | PR-B11 |
| B12 | 6/21/20 | PR-B12 |
| B13 | 8/20/20 | PR-B13 |
| B15 | 10/8/20 | PR-B15 |
| B19 | 12/16/20 | PR-B19 |

15-0035-02A
PM:
DRAWN BY: Author
01/30/18

MECHANICAL PLAN - NORTH GARAGE L1

M101.2

12/16/2020 3:41:36 PM BIM 360://COST-Costco Campus Parking Garage-15-0035-03/M-1690-02-BUILDING 5-R18.rvt